DATASHEET - ZE-1,0



Overload relay, Ir= 0.6 - 1 A, 1 N/O, 1 N/C, Direct mounting



Part no. ZE-1,0 Catalog No. 014376 Alternate Catalog XTOM001AC1 No. EL-Nummer 4130478 (Norway)

Delivery program

Product range			ZE overload relays for mini contactor relays
Phase-failure sensitivity			IEC/EN 60947, VDE 0660 Part 102
Description			Test/off button Reset pushbutton manual/auto Trip-free release
Mounting type			Direct mounting
Setting range			
Overload releases	١r	A	0.6 - 1
Contact sequence			97 95 $ \begin{array}{c} 97 95 \\ 1 \\ 1 \\ 1 \\ 1 \\ 2 \\ 4 \\ 6 \\ 98 \\ 96 \end{array}$
Auxiliary contacts			
N/O = Normally open			1 N/O
N/C = Normally closed			1 N/C
For use with			DILEM DIULEM/21/MV
Short-circuit protection			
Type "1" coordination	gG/gL	A	20
Type "2" coordination	gG/gL	A	4
Nataa			

Notes

Overload trigger: tripping class 10 A

Short circuit protection: observe the maximum permissible fuse of the contactor with direct device mounting.

Suitable for protection of Ex e-motors




II(2)G [Ex d] [Ex e] [Ex px]

PTB 10 ATEX 3014

Observe manual MN03407003Z-DE/EN.

Notes

When fitted directly to the contactor a clearance of at least 5 mm is required between the overload relays.



Technical data General

General			
Standards			IEC/EN 60947, VDE 0660, UL, CSA
Climatic proofing			Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30
Ambient temperature			
			Operating range to IEC/EN 60947 PTB: -5 °C - +55 °C
Open		°C	-25 - +50
Enclosed		°C	- 25 - 40
Temperature compensation			Continuous
Weight		kg	0.075
Mechanical shock resistance		g	10 Sinusoidal Shock duration 10 ms
Degree of Protection			IP20
Protection against direct contact when actuated from front (EN 50274)			Finger and back-of-hand proof
Altitude		m	Max. 2000
Main conducting paths			
Rated impulse withstand voltage	U _{imp}	V AC	6000
Overvoltage category/pollution degree			111/3
Rated insulation voltage	Ui	V	690
Rated operational voltage	U _e	V AC	690
Safe isolation to EN 61140			
Between auxiliary contacts and main contacts		V AC	300
Between main circuits		V AC	300
Temperatur compensation residual error > 40 °C			≦ 0.25 %/K
Current heat loss (3 conductors)			
Lower value of the setting range		W	2.5
Maximum setting		w	4.8
Terminal capacities		mm ²	
Solid		mm ²	1 x (0.75 - 2.5)
Flexible with ferrule		mm ²	1 x (0.5 - 1.5)
Solid or stranded		AWG	18 - 14
Terminal screw			M3.5
Tightening torque		Nm	1.2
Stripping length		mm	8
Tools			
Pozidriv screwdriver		Size	2
Standard screwdriver		mm	0.8 x 5.5
Auxiliary and control circuits			
Rated impulse withstand voltage	U _{imp}	V	4000
Overvoltage category/pollution degree			III/3
Terminal capacities		mm ²	
Solid		mm ²	1 x (0.75 - 2.5) 2 x (0.75 - 2.5)
Flexible with ferrule		mm ²	1 x (0.5 - 1.5)

			2 x (0.5 - 1.5)
Solid or stranded		AWG	2 x (18 - 12)
Terminal screw			M3.5
Tightening torque		Nm	1.2
Stripping length		mm	8
Tools			
Pozidriv screwdriver		Size	2
Standard screwdriver		mm	0.8 × 5.5
Rated insulation voltage	Ui	V AC	500
Rated operational voltage	U _e	V AC	500
Safe isolation to EN 61140			
between the auxiliary contacts		V AC	250
Conventional thermal current	I _{th}	А	6
Rated operational current	le	А	
AC-15			
Make contact			
120 V	Ι _e	Α	1.5
220 V 230 V 240 V	Ι _e	А	1.5
380 V 400 V 415 V	Ι _e	А	0.7
500 V	Ι _e	А	0.5
Break contact			
120 V	Ie	А	1.5
220 V 230 V 240 V	Ie	А	1.5
380 V 400 V 415 V	Ie	A	0.7
500 V	Ie	A	0.5
DC L/R ≦ 15 ms			
			Switch-on and switch-off conditions based on DC-13, time constant as specified.
24 V	Ie	A	0.9
60 V	Ie	A	0.75
110 V	I _e	A	0.4
220 V	۱ _e	A	0.2
Short-circuit rating without welding	-		
max. fuse		A gG/gL	4
Notes			

Notes Ambient air temperature: Operating range to IEC/EN 60947, PTB: -5°C to +50°C Main circuits terminal capacity solid and flexible conductors with ferrules: When using 2 conductors use equal cross-sections. Rating data for approved types Auxiliary contacts Pilot Duty D300 AC operated DC operated R300 General Use AC ٧ 240 V/1,5 A 600 V/0,6 A Short Circuit Current Rating SCCR **Basic Rating** Notes CB for max. 480 V SCCR kA 5 А 3 max. Fuse max. CB А 15

Design verification as per IEC/EN 61439

Tec	hnical data for design verification			
	Rated operational current for specified heat dissipation	In	А	1
	Heat dissipation per pole, current-dependent	P _{vid}	W	1.6

Static heat dissipation, non-current-dependentPvsW0Heat dissipation capacityPdissW0Operating ambient temperature min.*C-25Operating ambient temperature max.*C50IEC/EN 61439 design verification*C5010.2.2 Corrosion resistance*CMeets the product standard's requirements.10.2.3.1 Verification of thermal stability of enclosures*CMeets the product standard's requirements.10.2.3.2 Verification of resistance of insulating materials to normal heat*CMeets the product standard's requirements.10.2.3.3 Verification of resistance of insulating materials to abnormal heatMeets the product standard's requirements.10.2.4 Resistance to ultra-violet (UV) radiationMeets the product standard's requirements.10.2.5 LiftingSoes not apply, since the entire switchgear needs to be evaluated.10.3.1 Geree of protection of ASSEMBLIESSoes not apply, since the entire switchgear needs to be evaluated.10.4 Clearances and creepage distancesNeets the product standard's requirements.10.5 Protection against electric shockSoes not apply, since the entire switchgear needs to be evaluated.10.6 Incorporation of switching devices and componentsSoes not apply, since the entire switchgear needs to be evaluated.10.6 Incorporation of switching devices and componentsSoes not apply, since the entire switchgear needs to be evaluated.10.6 Incorporation of switching devices and componentsSoes not apply, since the entire switchgear needs to be evaluated.10.6 Incorporation of switching devices and components <th></th>	
Operating ambient temperature min.°C25Operating ambient temperature max.°C50IEC/EN 61439 design verification°C5010.2 Strength of materials and partsMeets the product standard's requirements.10.2.2 Corrosion resistanceMeets the product standard's requirements.10.2.3.1 Verification of thermal stability of enclosuresMeets the product standard's requirements.10.2.3.2 Verification of resistance of insulating materials to normal heatMeets the product standard's requirements.10.2.3.3 Verification of resistance of insulating materials to abnormal heatMeets the product standard's requirements.10.2.4 Resistance to ultra-violet (UV) radiationMeets the product standard's requirements.10.2.5 LiftingDoes not apply, since the entire switchgear needs to be evaluated.10.2.7 InscriptionsMeets the product standard's requirements.10.3 Degree of protection of ASSEMBLIESMeets the product standard's requirements.10.4 Clearances and creepage distancesMeets the product standard's requirements.10.5 Protection against electric shockMeets the product standard's requirements.10.6 Incorporation of switching devices and componentsDoes not apply, since the entire switchgear needs to be evaluated.10.6 Incorporation of switching devices and componentsDoes not apply, since the entire switchgear needs to be evaluated.10.7 Internal electrical circuits and connectionsLife panel builder's responsibility.	
Operating ambient temperature max.°C50IEC/EN 61439 design verification°C5010.2 Strength of materials and parts10.2.2 Corrosion resistanceMeets the product standard's requirements.10.2.3.1 Verification of thermal stability of enclosuresMeets the product standard's requirements.10.2.3.2 Verification of resistance of insulating materials to normal heatMeets the product standard's requirements.10.2.3.3 Verification of resistance of insulating materials to abnormal heatMeets the product standard's requirements.10.2.4 Resistance to ultra-violet (UV) radiationMeets the product standard's requirements.10.2.5 LiftingDoes not apply, since the entire switchgear needs to be evaluated.10.2.7 InscriptionsMeets the product standard's requirements.10.3.5 Degree of protection of ASSEMBLIESDoes not apply, since the entire switchgear needs to be evaluated.10.4 Clearances and creepage distancesMeets the product standard's requirements.10.5 Protection against electric shockDoes not apply, since the entire switchgear needs to be evaluated.10.6 Incorporation of switching devices and componentsDoes not apply, since the entire switchgear needs to be evaluated.10.7 Internal electric al circuits and connectionsMeets the product standard's requirements.	
IEC/EN 61439 design verification Mets the product standard's requirements. 10.2 Strength of materials and parts Meets the product standard's requirements. 10.2.2 Corrosion resistance Meets the product standard's requirements. 10.2.3.1 Verification of thermal stability of enclosures Meets the product standard's requirements. 10.2.3.2 Verification of resistance of insulating materials to normal heat and fire due to internal electric effects Meets the product standard's requirements. 10.2.4 Resistance to ultra-violet (UV) radiation Meets the product standard's requirements. 10.2.5 Lifting Meets the product standard's requirements. 10.2.6 Mechanical impact Does not apply, since the entire switchgear needs to be evaluated. 10.2.7 Inscriptions Meets the product standard's requirements. 10.3 Degree of protection of ASSEMBLIES Does not apply, since the entire switchgear needs to be evaluated. 10.4 Clearances and creepage distances Meets the product standard's requirements. 10.5 Protection against electric shock Does not apply, since the entire switchgear needs to be evaluated. 10.6 Incorporation of switching devices and components Does not apply, since the entire switchgear needs to be evaluated. 10.6 Incorporation of switching devices and connections Does not apply, since the entire switchgear needs to be evaluated. <td></td>	
10.2 Strength of materials and partsMeets the product standard's requirements.10.2.2 Corrosion resistanceMeets the product standard's requirements.10.2.3.1 Verification of thermal stability of enclosuresMeets the product standard's requirements.10.2.3.2 Verification of resistance of insulating materials to normal heatMeets the product standard's requirements.10.2.3.3 Verification of resistance of insulating materials to abnormal heatMeets the product standard's requirements.10.2.4 Resistance to ultra-violet (UV) radiationMeets the product standard's requirements.10.2.5 LiftingDoes not apply, since the entire switchgear needs to be evaluated.10.2.7 InscriptionsMeets the product standard's requirements.10.3 Degree of protection of ASSEMBLIESDoes not apply, since the entire switchgear needs to be evaluated.10.4 Clearances and creepage distancesMeets the product standard's requirements.10.5 Protection against electric shockDoes not apply, since the entire switchgear needs to be evaluated.10.6 Incorporation of switching devices and componentsDoes not apply, since the entire switchgear needs to be evaluated.10.7 Internal electrical circuits and connectionsDoes not apply, since the entire switchgear needs to be evaluated.	
10.2.2 Corrosion resistanceMeets the product standard's requirements.10.2.3.1 Verification of thermal stability of enclosuresMeets the product standard's requirements.10.2.3.2 Verification of resistance of insulating materials to normal heat and fire due to internal electric effectsMeets the product standard's requirements.10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effectsMeets the product standard's requirements.10.2.4 Resistance to ultra-violet (UV) radiationMeets the product standard's requirements.10.2.5 LiftingDoes not apply, since the entire switchgear needs to be evaluated.10.2.6 Mechanical impactDoes not apply, since the entire switchgear needs to be evaluated.10.2.7 InscriptionsMeets the product standard's requirements.10.3 Degree of protection of ASSEMBLIESDoes not apply, since the entire switchgear needs to be evaluated.10.4 Clearances and creepage distancesMeets the product standard's requirements.10.5 Protection against electric shockDoes not apply, since the entire switchgear needs to be evaluated.10.6 Incorporation of switching devices and componentsDoes not apply, since the entire switchgear needs to be evaluated.10.7 Internal electrical circuits and connectionsDoes not apply, since the entire switchgear needs to be evaluated.	
10.2.3.1 Verification of thermal stability of enclosuresMeets the product standard's requirements.10.2.3.2 Verification of resistance of insulating materials to normal heat and fire due to internal electric effectsMeets the product standard's requirements.10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effectsMeets the product standard's requirements.10.2.4 Resistance to ultra-violet (UV) radiationMeets the product standard's requirements.10.2.5 LiftingDoes not apply, since the entire switchgear needs to be evaluated.10.2.6 Mechanical impactDoes not apply, since the entire switchgear needs to be evaluated.10.3 Degree of protection of ASSEMBLIESDoes not apply, since the entire switchgear needs to be evaluated.10.4 Clearances and creepage distancesMeets the product standard's requirements.10.5 Protection against electric shockDoes not apply, since the entire switchgear needs to be evaluated.10.6 Incorporation of switching devices and componentsDoes not apply, since the entire switchgear needs to be evaluated.10.7 Internal electrical circuits and connectionsLift panel builder's responsibility.	
10.2.3.2 Verification of resistance of insulating materials to normal heatMeets the product standard's requirements.10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effectsMeets the product standard's requirements.10.2.4 Resistance to ultra-violet (UV) radiationMeets the product standard's requirements.10.2.5 LiftingDoes not apply, since the entire switchgear needs to be evaluated.10.2.6 Mechanical impactDoes not apply, since the entire switchgear needs to be evaluated.10.3 Degree of protection of ASSEMBLIESDoes not apply, since the entire switchgear needs to be evaluated.10.4 Clearances and creepage distancesMeets the product standard's requirements.10.5 Protection against electric shockDoes not apply, since the entire switchgear needs to be evaluated.10.6 Incorporation of switching devices and componentsDoes not apply, since the entire switchgear needs to be evaluated.10.7 Internal electrical circuits and connectionsDoes not apply, since the entire switchgear needs to be evaluated.	
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effectsMeets the product standard's requirements.10.2.4 Resistance to ultra-violet (UV) radiationMeets the product standard's requirements.10.2.5 LiftingDoes not apply, since the entire switchgear needs to be evaluated.10.2.6 Mechanical impactDoes not apply, since the entire switchgear needs to be evaluated.10.3 Degree of protection of ASSEMBLIESDoes not apply, since the entire switchgear needs to be evaluated.10.4 Clearances and creepage distancesMeets the product standard's requirements.10.5 Protection against electric shockDoes not apply, since the entire switchgear needs to be evaluated.10.6 Incorporation of switching devices and componentsMeets the product standard's requirements.10.7 Internal electrical circuits and connectionsLift panel builder's responsibility.	
and fire due to internal electric effectsAll of the due to internal electric effects10.2.4 Resistance to ultra-violet (UV) radiationMeets the product standard's requirements.10.2.5 LiftingDoes not apply, since the entire switchgear needs to be evaluated.10.2.6 Mechanical impactDoes not apply, since the entire switchgear needs to be evaluated.10.2.7 InscriptionsMeets the product standard's requirements.10.3 Degree of protection of ASSEMBLIESDoes not apply, since the entire switchgear needs to be evaluated.10.4 Clearances and creepage distancesMeets the product standard's requirements.10.5 Protection against electric shockMeets the product standard's requirements.10.6 Incorporation of switching devices and componentsDoes not apply, since the entire switchgear needs to be evaluated.10.7 Internal electrical circuits and connectionsMeets the panel builder's responsibility.	
10.2.5 LiftingDoes not apply, since the entire switchgear needs to be evaluated.10.2.6 Mechanical impactDoes not apply, since the entire switchgear needs to be evaluated.10.2.7 InscriptionsMeets the product standard's requirements.10.3 Degree of protection of ASSEMBLIESDoes not apply, since the entire switchgear needs to be evaluated.10.4 Clearances and creepage distancesMeets the product standard's requirements.10.5 Protection against electric shockDoes not apply, since the entire switchgear needs to be evaluated.10.6 Incorporation of switching devices and componentsDoes not apply, since the entire switchgear needs to be evaluated.10.7 Internal electrical circuits and connectionsInternal electrical circuits and connections	
10.2.6 Mechanical impactDoes not apply, since the entire switchgear needs to be evaluated.10.2.7 InscriptionsMeets the product standard's requirements.10.3 Degree of protection of ASSEMBLIESDoes not apply, since the entire switchgear needs to be evaluated.10.4 Clearances and creepage distancesMeets the product standard's requirements.10.5 Protection against electric shockDoes not apply, since the entire switchgear needs to be evaluated.10.6 Incorporation of switching devices and componentsDoes not apply, since the entire switchgear needs to be evaluated.10.7 Internal electrical circuits and connectionsInternal electrical circuits and connections	
10.2.7 InscriptionsMeets the product standard's requirements.10.3 Degree of protection of ASSEMBLIESDoes not apply, since the entire switchgear needs to be evaluated.10.4 Clearances and creepage distancesMeets the product standard's requirements.10.5 Protection against electric shockDoes not apply, since the entire switchgear needs to be evaluated.10.6 Incorporation of switching devices and componentsDoes not apply, since the entire switchgear needs to be evaluated.10.7 Internal electrical circuits and connectionsInternal electrical circuits and connections	
10.3 Degree of protection of ASSEMBLIESDoes not apply, since the entire switchgear needs to be evaluated.10.4 Clearances and creepage distancesMeets the product standard's requirements.10.5 Protection against electric shockDoes not apply, since the entire switchgear needs to be evaluated.10.6 Incorporation of switching devices and componentsDoes not apply, since the entire switchgear needs to be evaluated.10.7 Internal electrical circuits and connectionsInternal electrical circuits and connections	
10.4 Clearances and creepage distances Meets the product standard's requirements. 10.5 Protection against electric shock Does not apply, since the entire switchgear needs to be evaluated. 10.6 Incorporation of switching devices and components Does not apply, since the entire switchgear needs to be evaluated. 10.7 Internal electrical circuits and connections Is the panel builder's responsibility.	
10.5 Protection against electric shockDoes not apply, since the entire switchgear needs to be evaluated.10.6 Incorporation of switching devices and componentsDoes not apply, since the entire switchgear needs to be evaluated.10.7 Internal electrical circuits and connectionsIs the panel builder's responsibility.	
10.6 Incorporation of switching devices and components Does not apply, since the entire switchgear needs to be evaluated. 10.7 Internal electrical circuits and connections Is the panel builder's responsibility.	
10.7 Internal electrical circuits and connections Is the panel builder's responsibility.	
10.8 Connections for external conductors Is the panel builder's responsibility.	
10.9 Insulation properties	
10.9.2 Power-frequency electric strength Is the panel builder's responsibility.	
10.9.3 Impulse withstand voltage Is the panel builder's responsibility.	
10.9.4 Testing of enclosures made of insulating material Is the panel builder's responsibility.	
10.10 Temperature rise The panel builder is responsible for the temperature rise calculation. E provide heat dissipation data for the devices.	aton will
10.11 Short-circuit rating Is the panel builder's responsibility. The specifications for the switchg observed.	ear must be
10.12 Electromagnetic compatibility Is the panel builder's responsibility. The specifications for the switchg observed.	ear must be
10.13 Mechanical function The device meets the requirements, provided the information in the installeaflet (IL) is observed.	struction

Technical data ETIM 7.0

Low-voltage industrial components (EG000017) / Thermal overload relay (EC000106))	
Electric engineering, automation, process control engineering / Low-voltage switch technology / Overload protection device / Thermal overload relay (ecl@ss10.0.1-27-37-15-01 [AKF075014])		
Adjustable current range	А	0.6 - 1
Max. rated operation voltage Ue	V	690
Mounting method		Direct attachment
Type of electrical connection of main circuit		Screw connection
Number of auxiliary contacts as normally closed contact		1
Number of auxiliary contacts as normally open contact		1
Number of auxiliary contacts as change-over contact		0
Release class		CLASS 10
Reset function input		No
Reset function automatic		Yes
Reset function push-button		Yes

Approvals

Approvato	
Product Standards	UL 508; CSA-C22.2 No. 14; IEC/EN 60947-4-1; IEC/EN 60947-5-1; CE marking
UL File No.	E29184
UL Category Control No.	NKCR
CSA File No.	12528
CSA Class No.	3211-03
North America Certification	UL listed, CSA certified


Specially designed for North America	
Suitable for	
Max. Voltage Rating	
Degree of Protection	

No

Branch circuits 600 V AC

IEC: IP20, UL/CSA Type: -

Characteristics

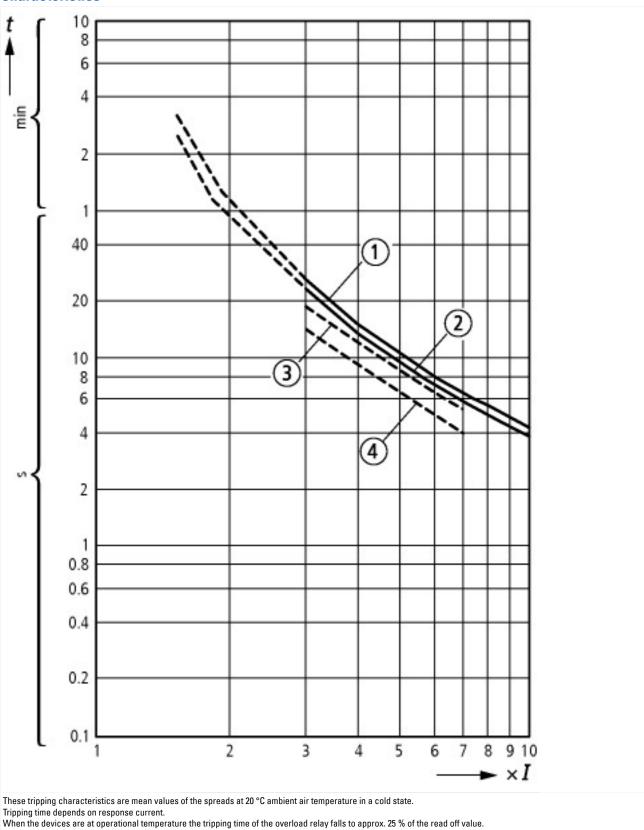


1: Minimum level, 3-phase

2: Maximum level, 3-phase

3: Minimum marker, 2-phase

4: Highest marker, 2-phase

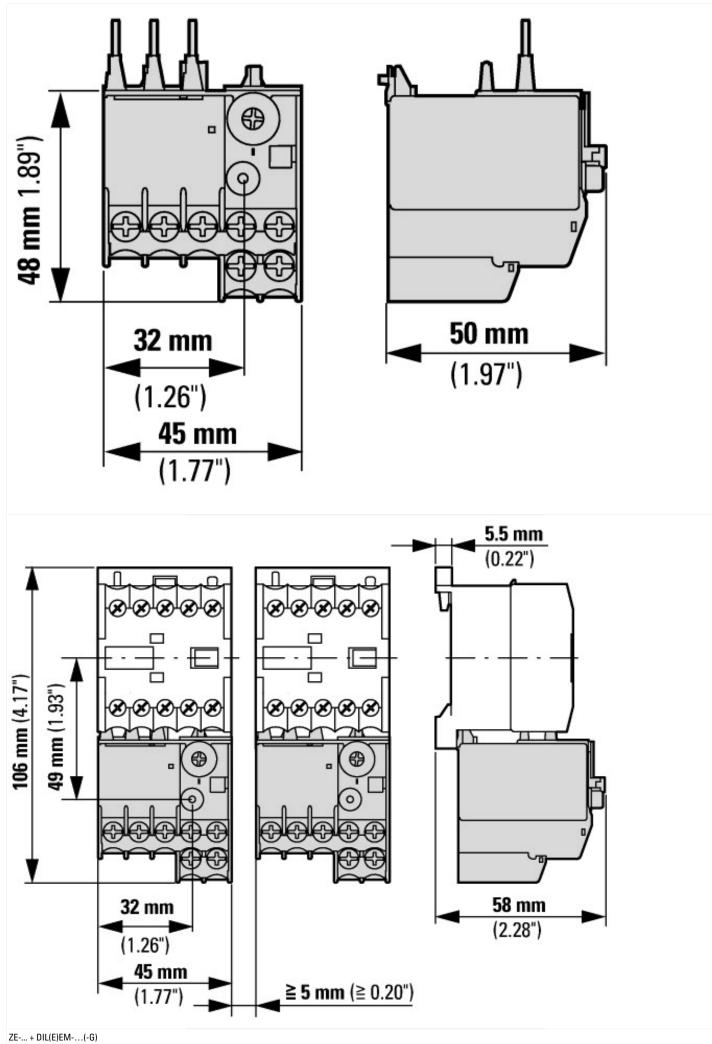

Assets (links)

Declaration of CE Conformity 00002849

Instruction Leaflets IL03407007Z2018_03

Manuals MN03407003Z_DE_EN (English)