

# AS-400 Card Remote Shutdown Quick Guide

V. 3.0

## 1. Product Outlook

### DB-9 port




Top View




Side View

### 9-pin port



Top View



Side View


## 2. Product Introduction

The AS400 communication card provides contact closures for remote monitoring your UPS. To meet different application requirement, the AS400 card is capable of selection the status of the dry-contact signal (active close or active open) by setting jumper. The suitable applications are listed below:

- IBM Server, Personal PC & Workstations equipments
- Auto-controlled industrial equipment & communication applications

## 3. Installation

**Step 1:** Remove cover of Intelligent Slot on the rear panel of the UPS.

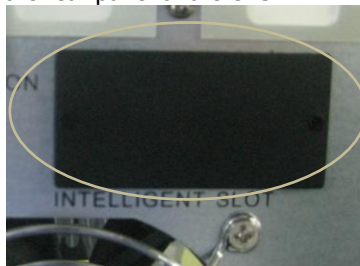


**Step 3:** The cover of AS400 should attach close to the rear panel. Using screwdriver, secure the AS400 to the UPS chassis with 2 screws.



**Step 2:** Insert AS400 card into Intelligent Slot.




**Step 4:** Use the 9-pin communication cable to connect UPS and equipment to implement the remote monitoring and control.

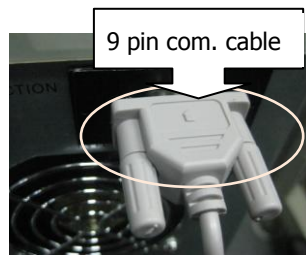


## 4. Specifications

### Internal circuit of DB-9 port

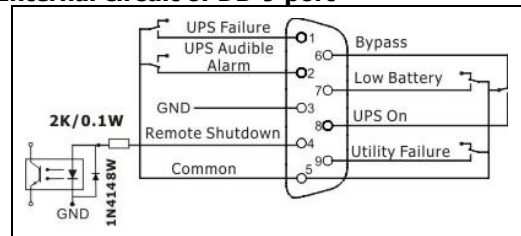

RS-232 port



9-pin port

### Electric Parameter of DB-9 port

|           | Parameter            | Symbol       | Max. | Min. | Unit |
|-----------|----------------------|--------------|------|------|------|
| Resistor* | DC Current           | $I_R$        | 6    | 1    | mA   |
| Diode     | Reverse Voltage      | $V_R$        | 6    | -    | V    |
|           | Forward Current      | $I_F$        | 50   | -    | mA   |
|           | Peak Forward Current | $I_F$ (Peak) | 1    | -    | A    |
| Relay     | DC Voltage           | $V_{DC}$     | 24   | -    | V    |
|           | DC Current           | $I_{DC}$     | 1.0  | -    | A    |

**Note:** It's required to retain the DC current lower than 6mA. Otherwise, it's necessary to add one resistor within DC current limitation in the serial loop of Remote Shutdown. (e.g. 2K resistor with at least 0.1W rating power). Refer to diagrams in **Application**.

### Pin Assignment

| Pin Assignment | Function               | I/O          |
|----------------|------------------------|--------------|
| Pin 1          | UPS Failure            | O/P          |
| Pin 2          | UPS Audible Alarm      | O/P          |
| Pin 3          | GND (Common for Pin 4) | Power Ground |
| Pin 4          | Remote Shutdown        | I/P          |
| Pin 5          | Common for Relays      | Power Supply |
| Pin 6          | Bypass Active          | O/P          |
| Pin 7          | Low Battery            | O/P          |
| Pin 8          | UPS On                 | O/P          |
| Pin 9          | Utility Failure        | O/P          |


**P.S.** The shutdown pin (pin4 & pin3) only accepts 3-10s high level signal to perform the UPS shutdown.

### Function Description

| AC Status               | AO Status                  | Reason   |
|-------------------------|----------------------------|--|
| Pin 1 & Pin 5 connected | Pin 1 & Pin 5 disconnected | UPS failure  |
| Pin 2 & Pin 5 connected | Pin 2 & Pin 5 disconnected | UPS failure, utility failure, low battery, bypass active |
| Pin 6 & Pin 5 connected | Pin 6 & Pin 5 disconnected | Bypass active  |
| Pin 7 & Pin 5 connected | Pin 7 & Pin 5 disconnected | Battery voltage is low                                   |
| Pin 8 & Pin 5 connected | Pin 8 & Pin 5 disconnected | UPS is in inverter mode                                  |
| Pin 9 & Pin 5 connected | Pin 9 & Pin 5 disconnected | Utility failure  |

## Application:

Below shows the circuit of basic application to implement monitoring and control.

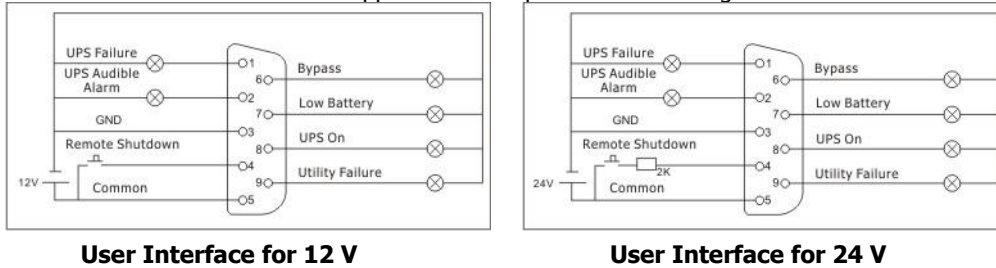


**User Interface for 12 V**

**User Interface for 24 V**


## 5. Internal Logical Connection

IC controller of the card controls actions of 5 relays depending on the UPS status. Active-Close(A.C) terminal and Active-Open(A.O) terminal of each relay connect to pin 3 and pin 1 of a 3-pin connector respectively. The pin 2 of the 3-pin connector connects to the signal pin of the DB9 interface connector. The 2-pin jumper can be plugged to the 3-pin connector to either short-circuit Pin1 & Pin2(A.C) or short-circuit Pin3 & Pin2(A.O).

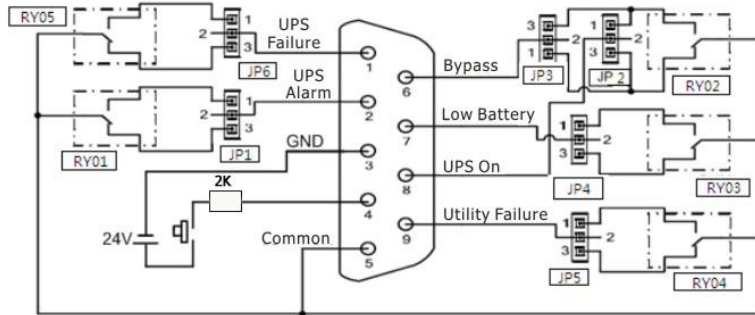


**Fig 1 Pin definition and internal logical connection**

Accordingly, if pin1 short-circuits with pin2 via the jumper, the status of dry contact signal will be ACTIVE CLOSE, refer to Fig 2. When the signal is active, the signal pin on the DB9 connector will connect with the common pin (pin5) via the relay.

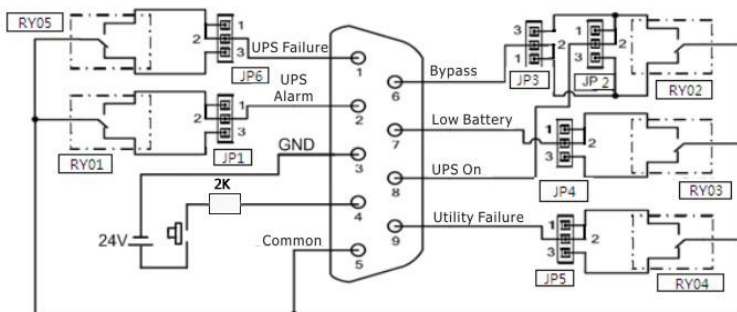

**Fig 2 Connection for ACTIVE CLOSE**

If Pin3 short-circuit with Pin2(A.O) via the jumper, the status of dry contact signal will be ACTIVE OPEN, refer to Fig 3. When the signal is active, the signal pin on the DB9 connector will disconnect with the common pin (pin5) via the relay.

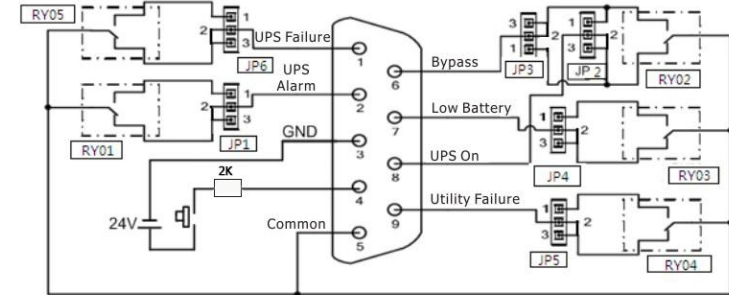

**Fig. 3 Connection for ACTIVE OPEN**

## 6 Jumper Set-up

The 3-pin connectors can be easily found just near to the relay. Refer to Fig. 4.



**Fig.4 AS400 card**

There are AC and AO white silk printings of the connector as shown in Fig. 5 to indicate pin1&2 in A.C and pin2&3 in A.O.



**Fig. 5 AO and AC silk printings indicates each 3-pin connector status**  
To achieve ACTIVE CLOSE dry-contact signal, the jumper should connect the two pins (Pin1&2) as shown in Fig. 6.



**Fig. 6 Jumper setting for ACTIVE CLOSE**



**Fig. 7 Jumper setting for ACTIVE OPEN**

## Jumper function description

| JP | Description        | JP | Description             |
|----|--------------------|----|-------------------------|
| 1  | UPS alarm (DB9.P2) | 4  | Low battery(DB9.P7)     |
| 2  | UPS on(DB9.P8)     | 5  | Utility failure(DB9.P9) |
| 3  | Bypass(DB9.P6)     | 6  | UPS failure(DB9.P1)     |